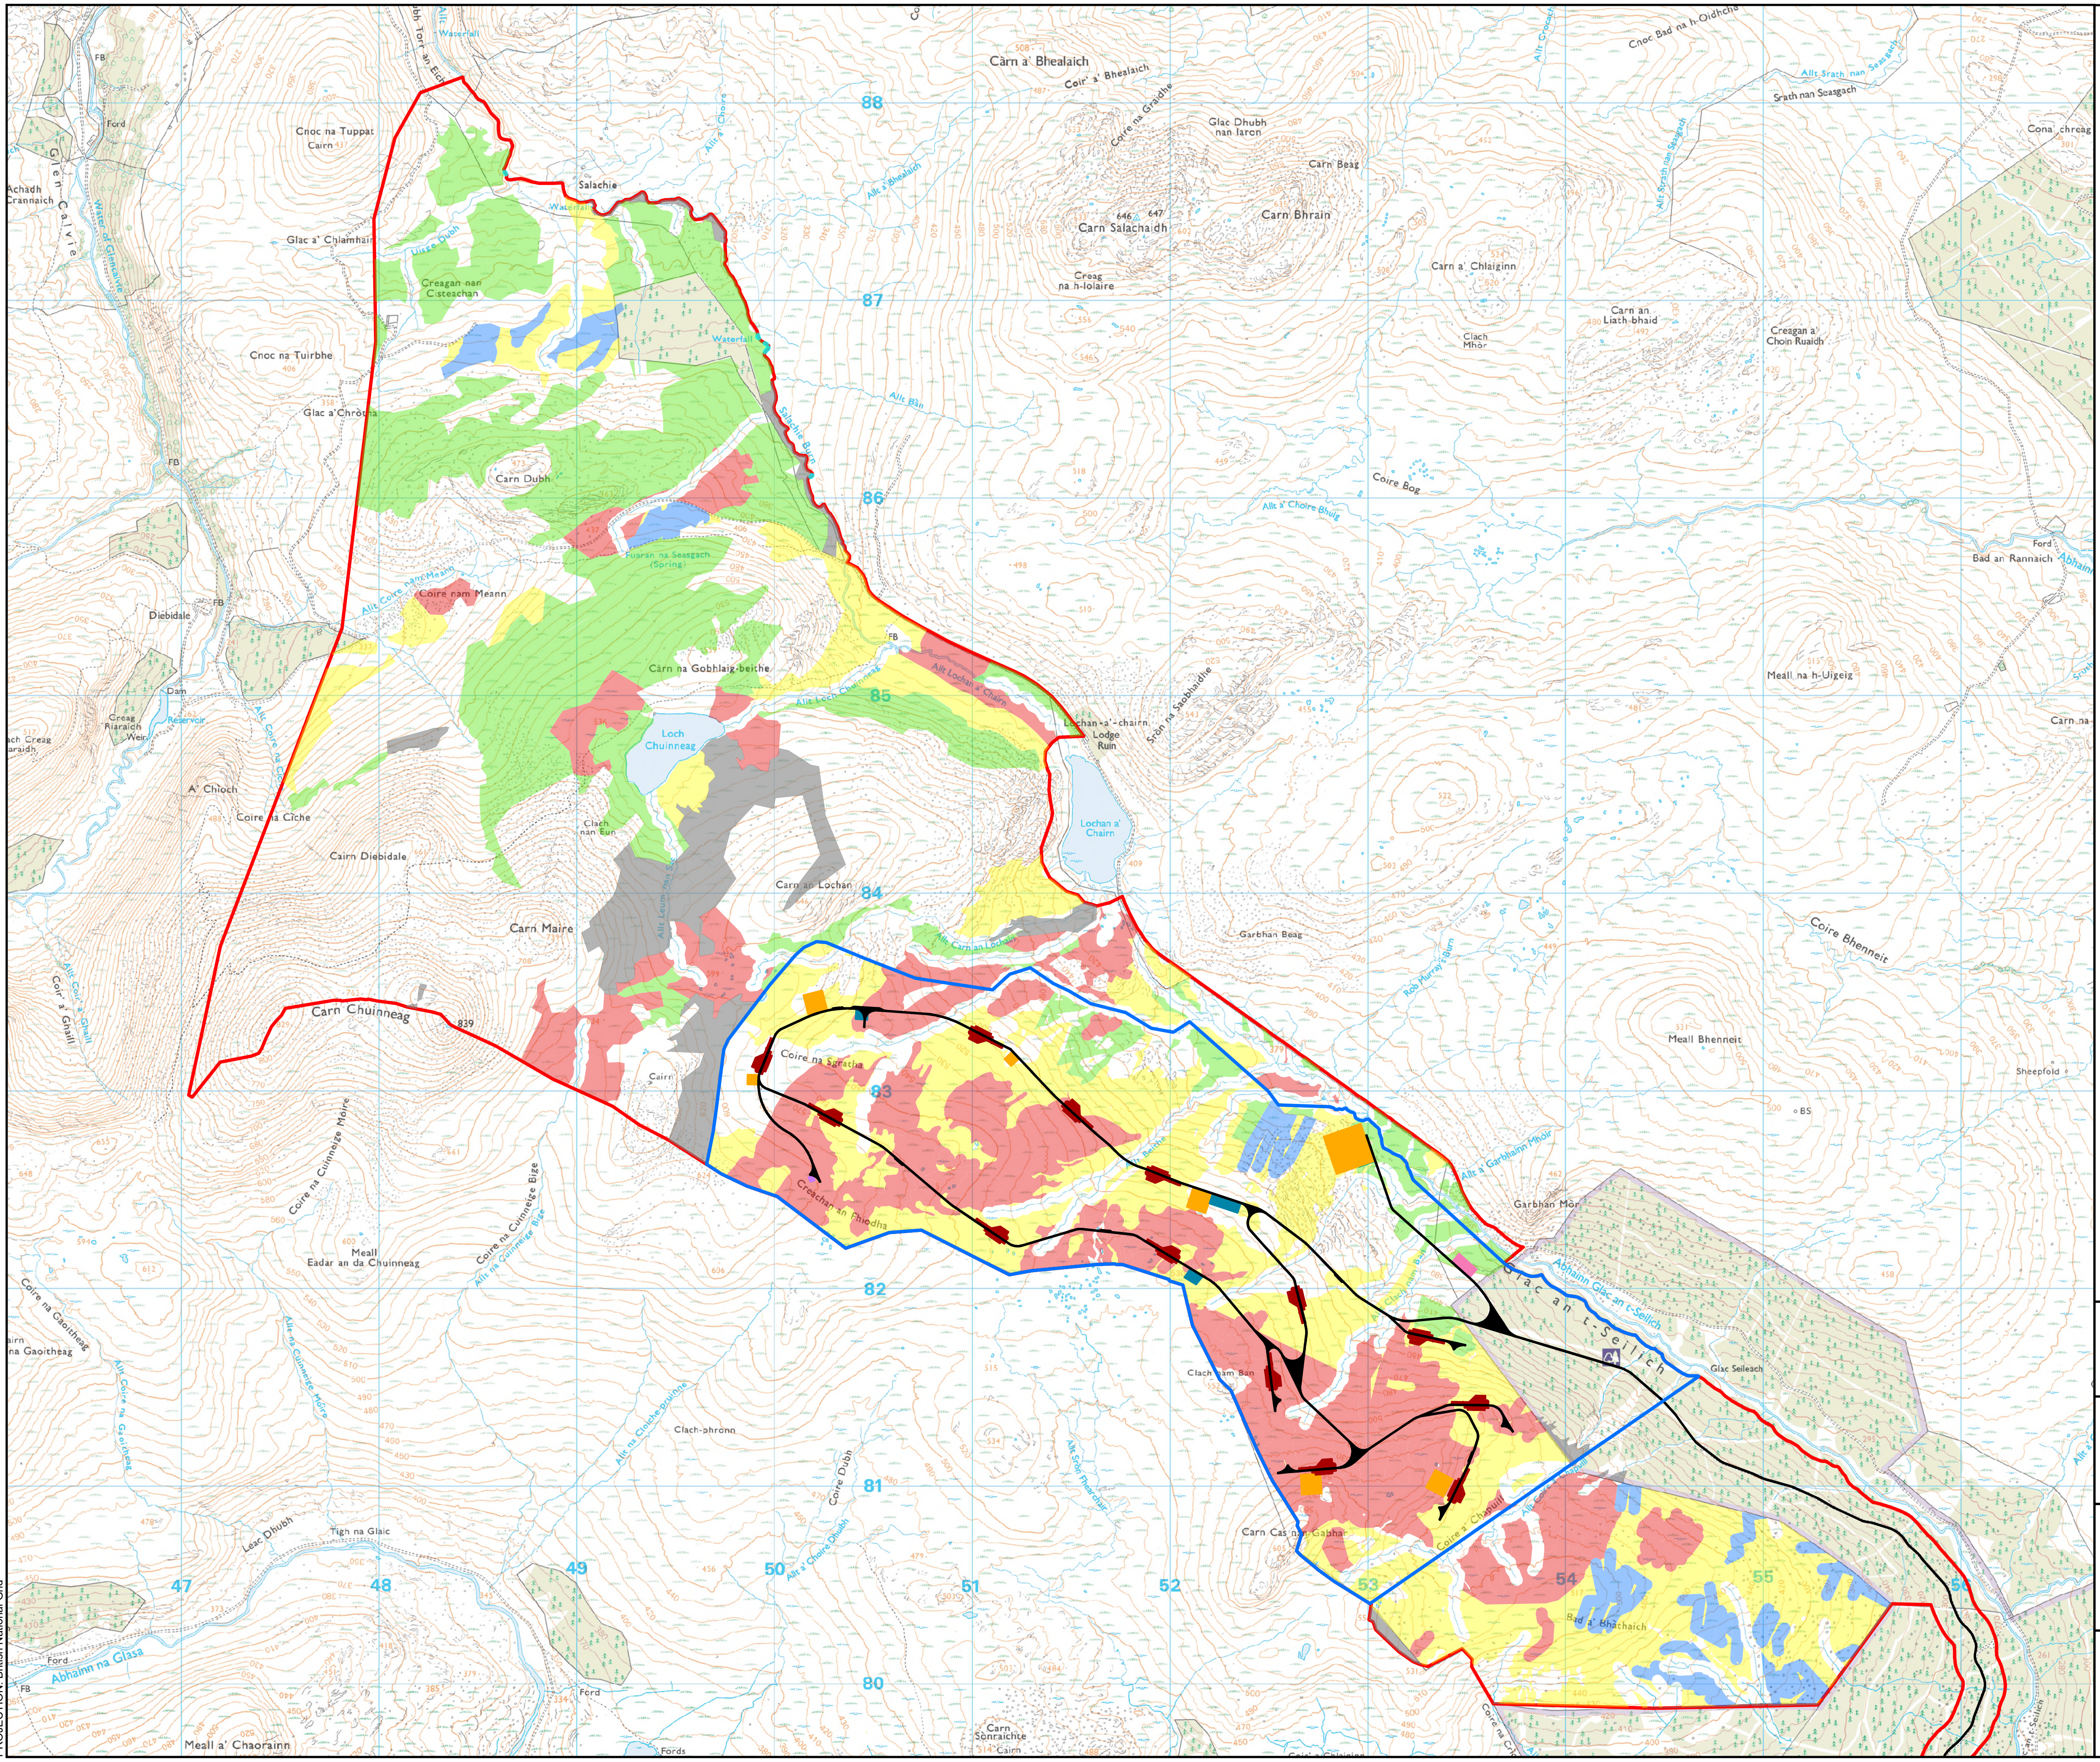

Site Boundary

Main Development Area

Site Infrastructure

- Met Mast Hardstanding
- Control Building and Substation
- BESS Site
- Borrow Pit Search Area
- Cranepad and Laydown
- Temporary Compound
- Access Track

Peatland Condition Assessment (PCA)

- Near Natural
- Modified
- Drained Peat
- Actively Eroding
- PCA not assigned

0 500 1,000 1,500

Metres

N

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: RW
PROJECT: 0730493	CHECKED: ST
DATE: 06/11/2025	APPROVED: RP

Figure 8.7
Peatland Condition Assessment Results
Creachan Wind Farm

ERM

PROJECTION: British National Grid

Contains OS data © Crown copyright 0000848182 2025

Path: \\UKSPRDGISFS01\Data\London\Projects\0730493 - Creachan\Maps\0730493 - Creachan.aprx